



IL PERCORSO DIAGNOSTICO TERAPEUTICO DEL CARCINOMA DEL DISTRETTO TESTA-COLLO

Il ruolo della Chirurgia Maxillo Facciale

Stefano Mandrioli

*U.O. Chirurgia Maxillo Facciale
AOU Arcispedale S. Anna, Ferrara
(Direttore: Prof. M. Galì)*



Sabato 13 maggio 2023
Aula Magna

Nuovo Ospedale S. Anna

Cona - Ferrara





- Sinergia con il Team
- Condivisione della strategia operativa con ORL e
Chirurgo Plastico
- Programmazione chirurgica








Grande importanza rivestono oggi le nuove tecnologie che permettono, mediante l'acquisizione della TC del paziente, di produrre materiali personalizzati sul paziente (c.d. *custom made*)

- Più dettagliata programmazione chirurgica
- Maggiore precisione durante l'atto operatorio
- Riduzione della morbilità



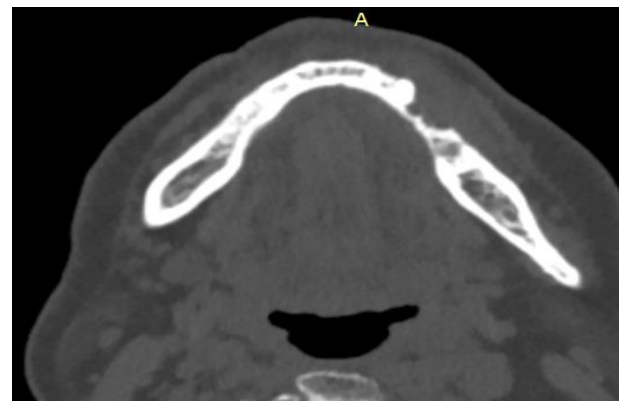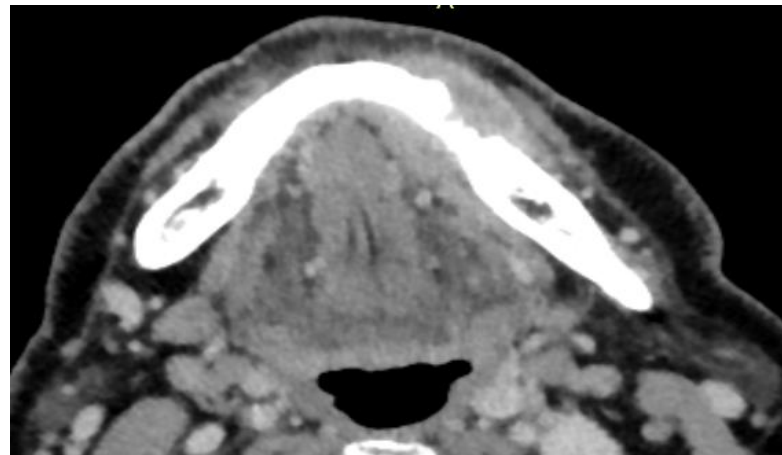
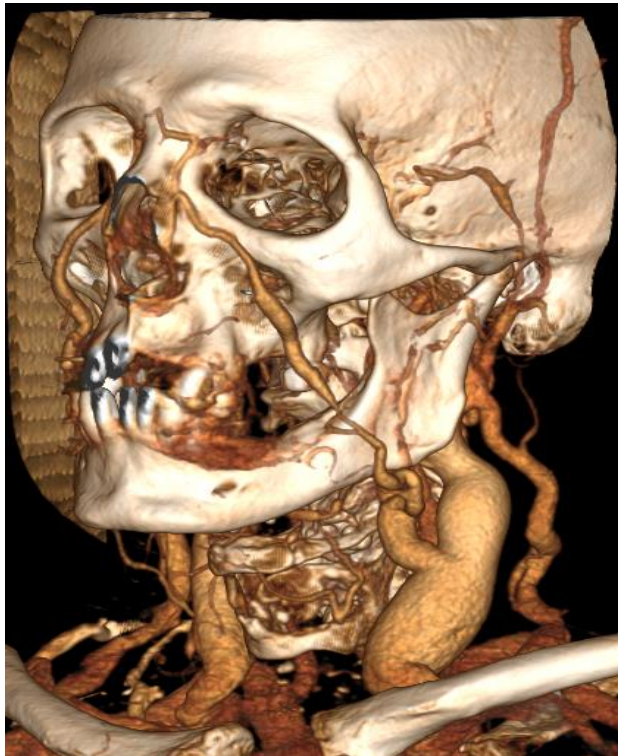


IPS Case Report C3931672

CONFIDENTIAL

Rev00


marking & drill guide/s

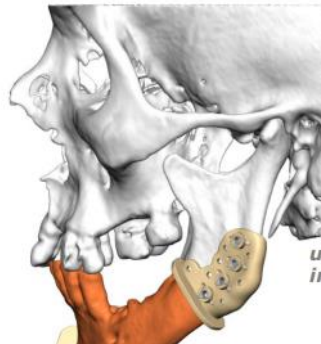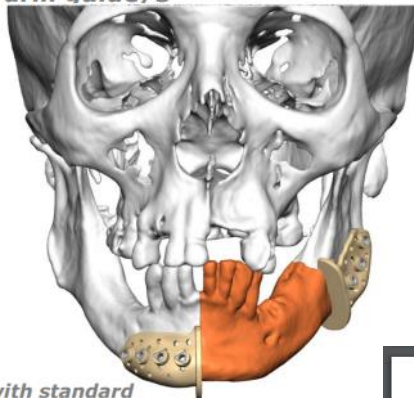

use drill without stop,
irrigate drill



Guide fixation with standard
screws or drill-free screws **only**
Diameter of fixation holes $\varnothing 2,1$
mm

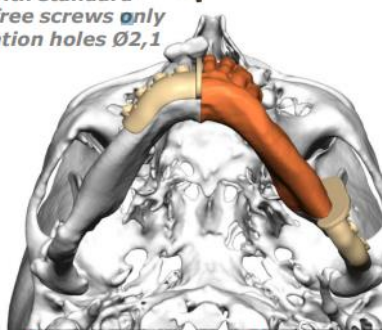

C3931672

Pat.: C.D.E.





KLS martin
GROUP

IPS Case Report C3931672

CONFIDENTIAL

Rev00

implant/s plate thickness: 3.0mm / screw system: 2.7mm on bone, 2.0mm on gap

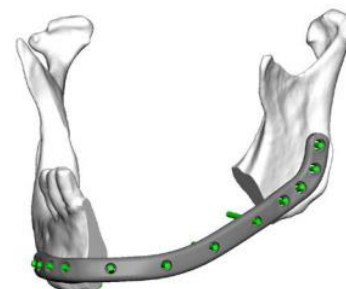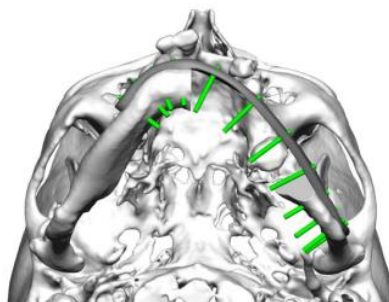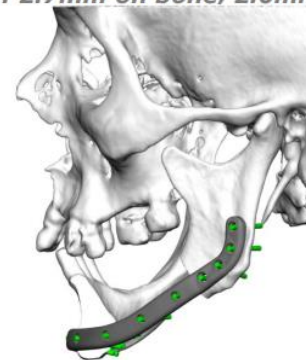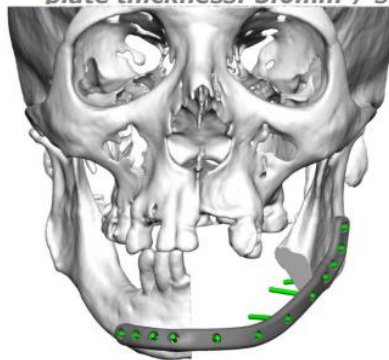

C3931672


Pat.: C.D.E.

KLS martin
GROUP

Designer: J. Los Arcos

14.01.2022


5

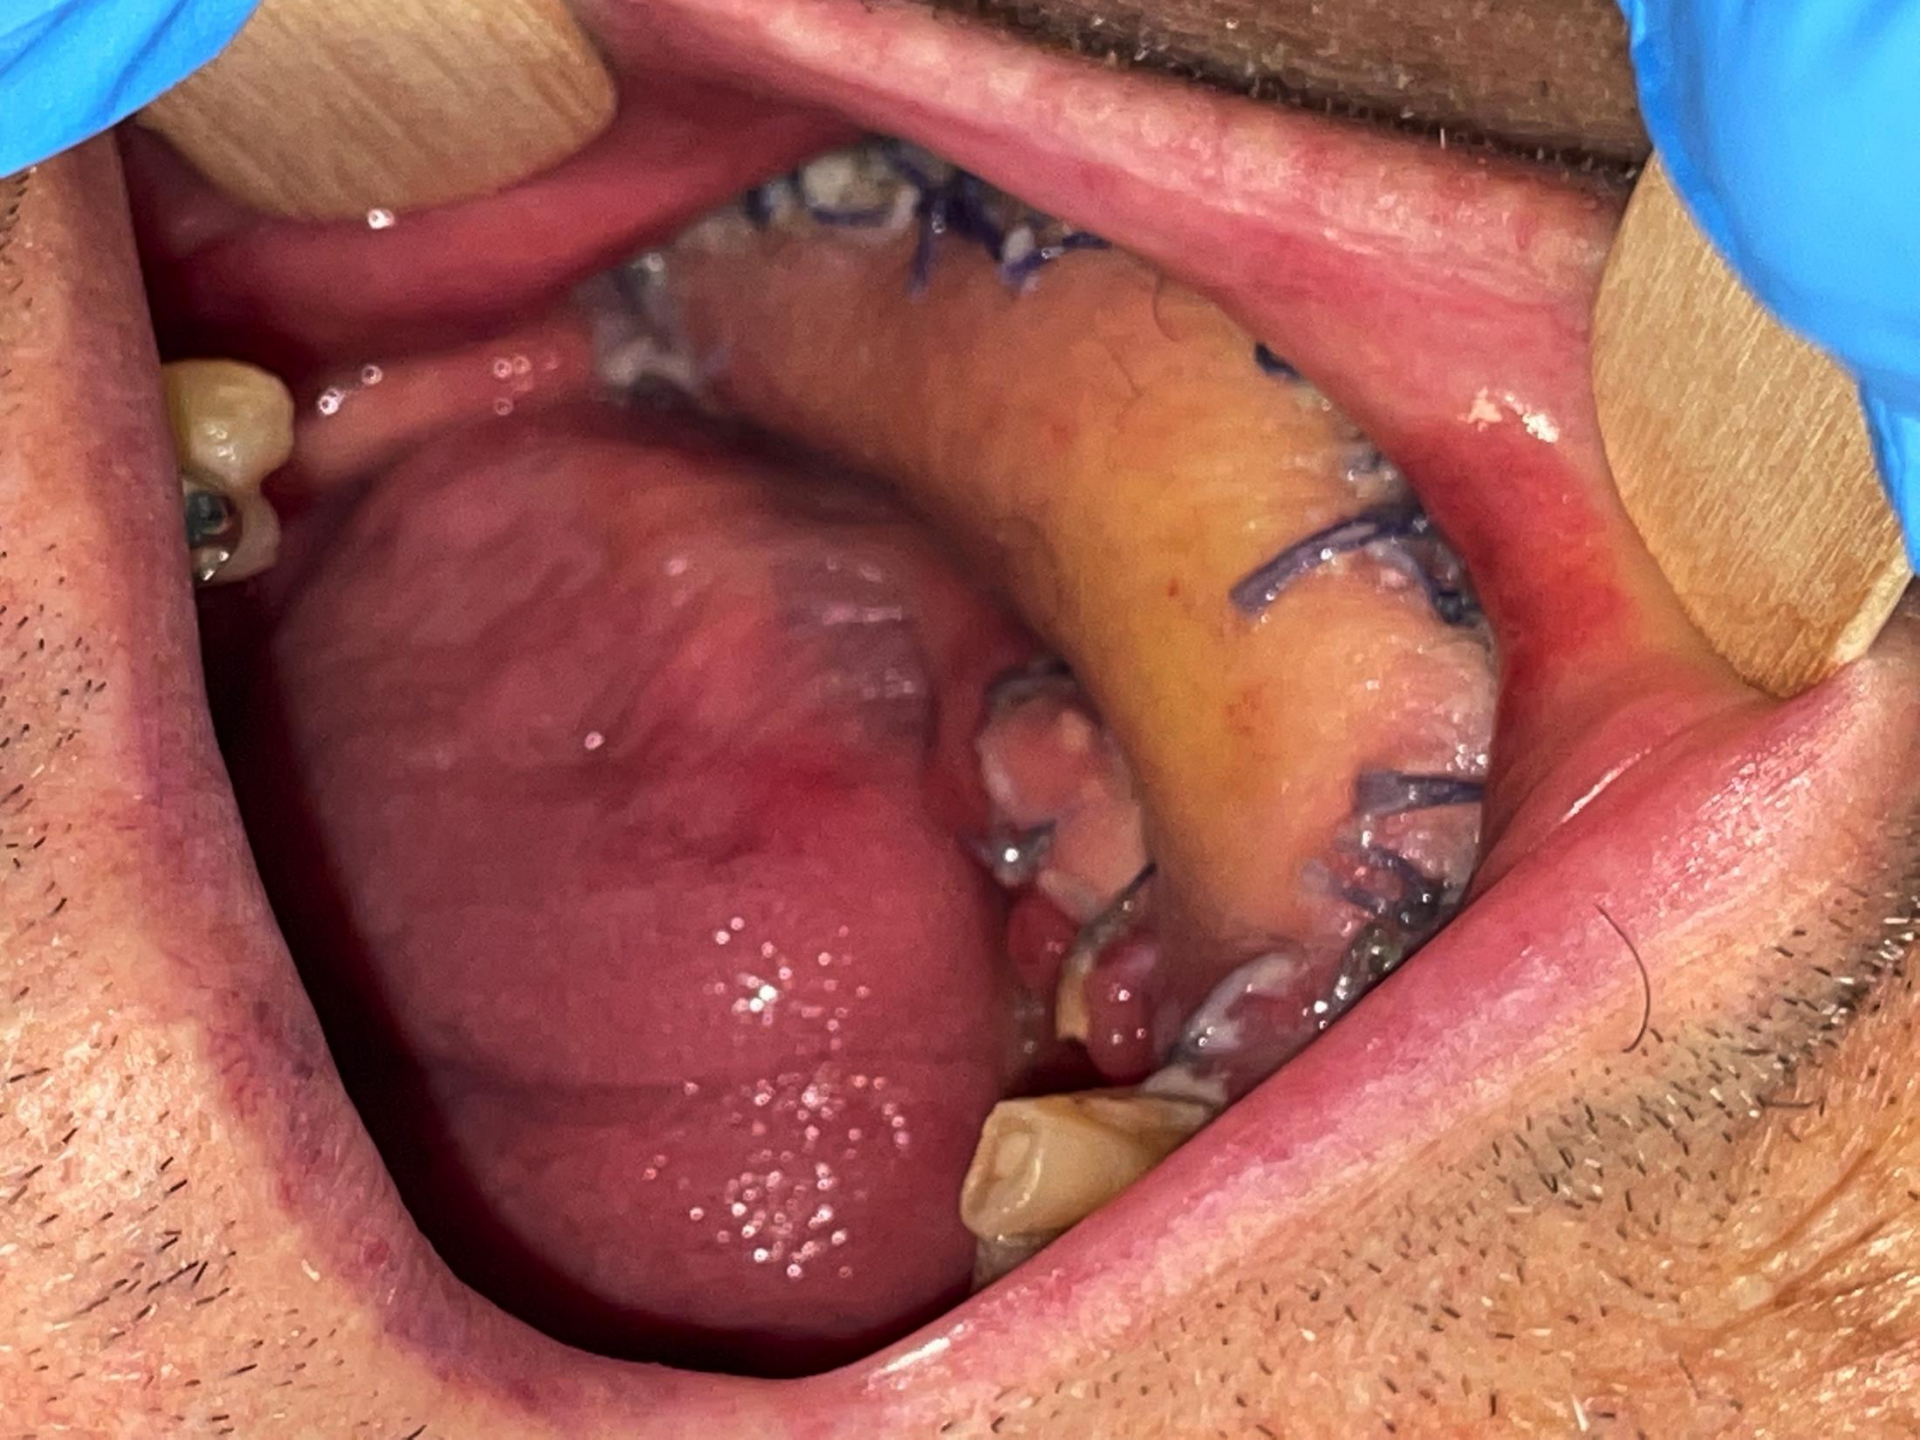

055694 /
line esame: ORTOPANORAMICA ARCADE DENTARIE (OPT)


07-09-2019
C:20

01/14

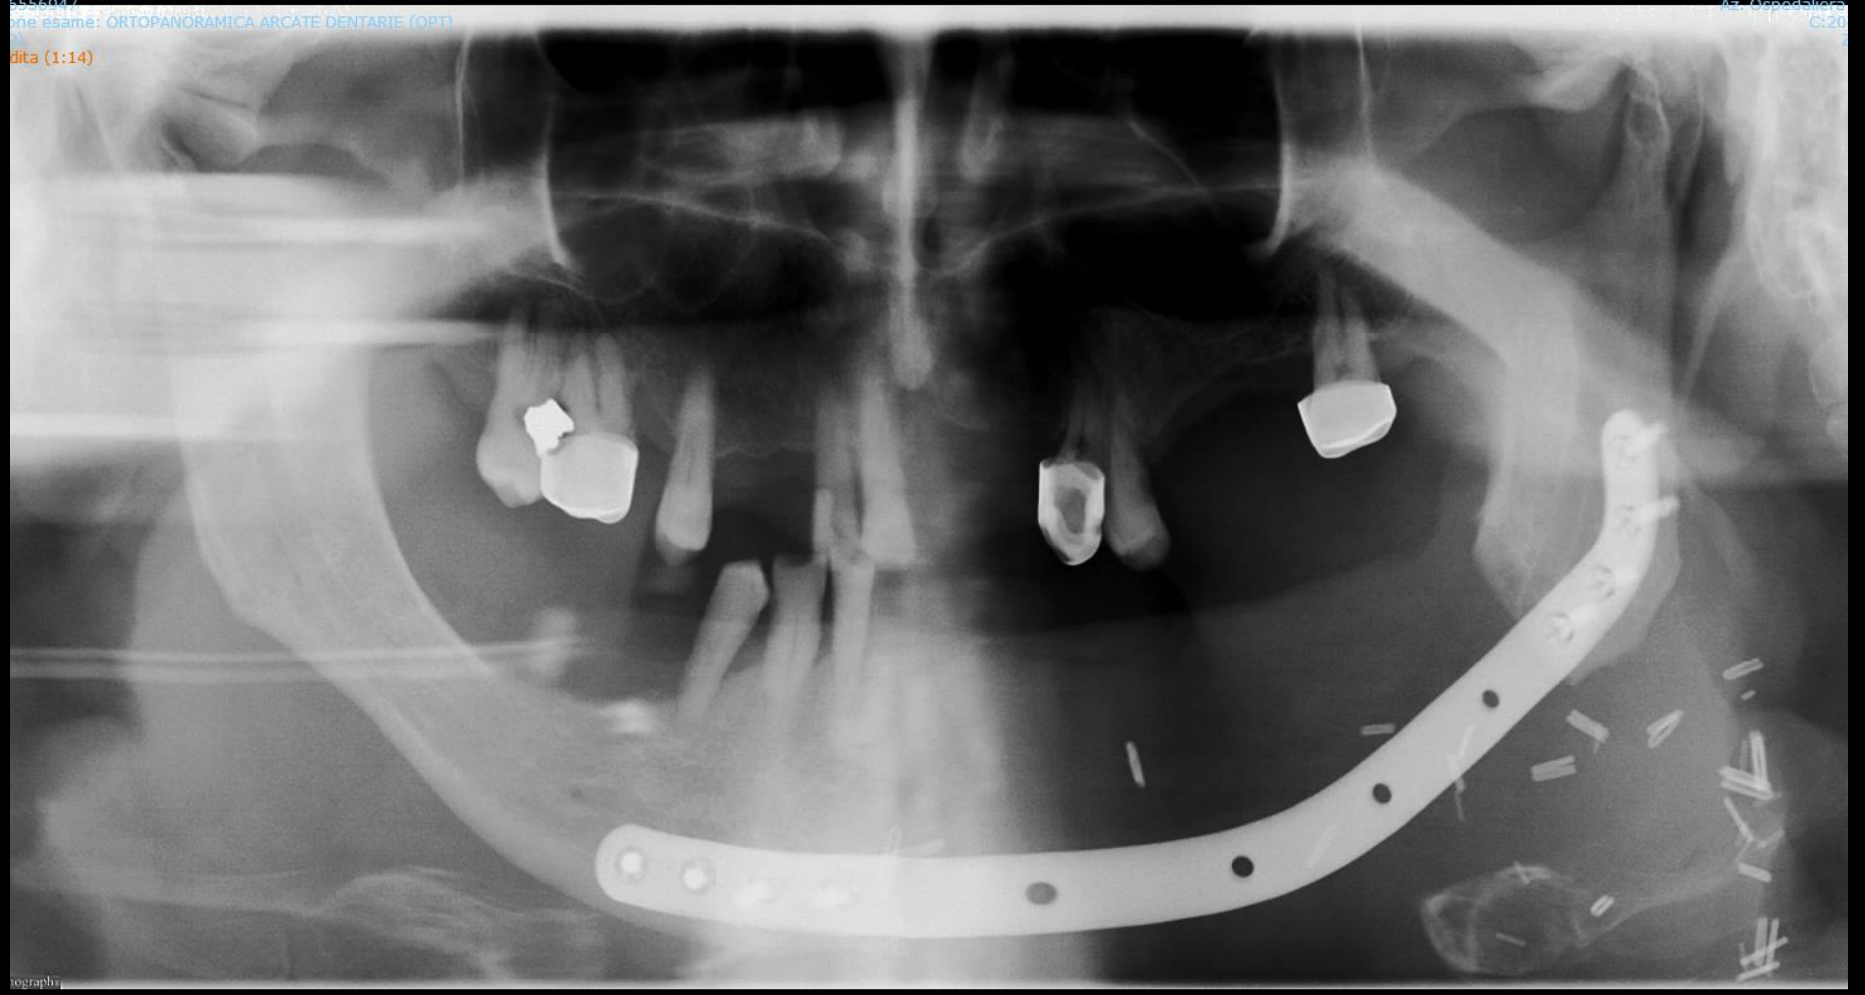

radiography

marking & drill guide/s

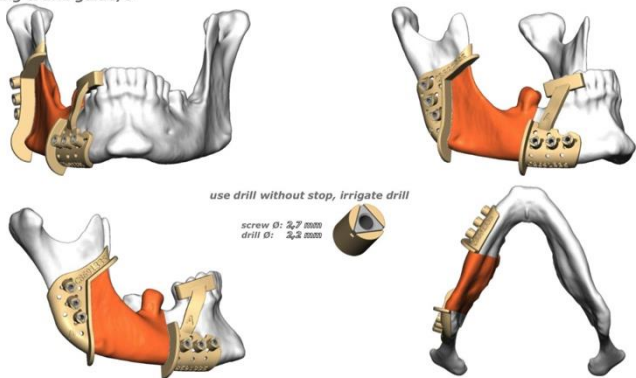

use drill without stop, irrigate drill

screw Ø: 2,7 mm
drill Ø: 2,3 mm

Guide fixation with standard screws or drill-free screws only. Diameter of fixation holes Ø2,1 mm


C8691335 Pat.: A.F. KLS martin Designer: J.Martin 08.10.2020 5

IPS Case Report C8691335

CONFIDENTIAL

Rev00

marking & drill guide/s

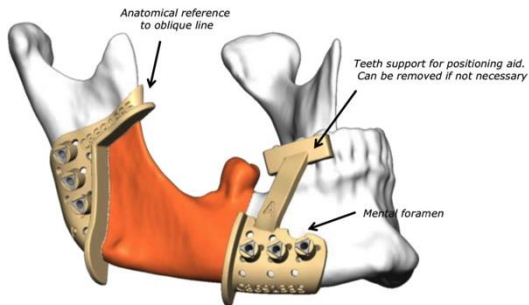


C8691335 Pat.: A.F. KLS martin Designer: J.Martin 08.10.2020 6

IPS Case Report C8691335

CONFIDENTIAL

Rev00

resection

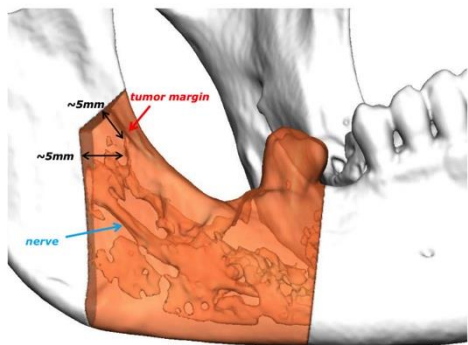


IPS Case Report C8691335

CONFIDENTIAL

Rev00

implant/s plate thickness: 3,0 mm / screw system: 2,7 mm

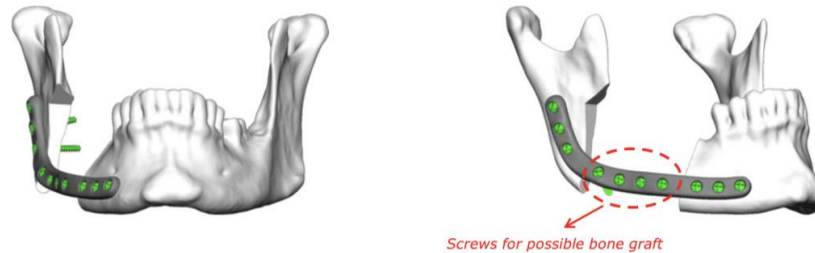

C8691335 Pat.: A.F. KLS martin Designer: J.Martin 08.10.2020 8


IPS Case Report C8691335

CONFIDENTIAL

Rev00

screws plate thickness: 3,0 mm

Screw Type	Pos.	Theoretical Screw Length*	Suggested Screw Length
Ø 2.7 Locking (bicort.)	1	10,2	9
Ø 2.7 Locking (bicort.)	2	10,0	9
Ø 2.7 Locking (bicort.)	3	8,9	9
Ø 2.0 Locking (monocort.)	4	-	(7-9)
Ø 2.0 Locking (monocort.)	5	-	(7-9)
Ø 2.0 Locking (monocort.)	6	-	(7-9)
Ø 2.0 Locking (monocort.)	7	-	(7-9)
Ø 2.7 Locking (bicort.)	8	13,7	13
Ø 2.7 Locking (bicort.)	9	13,7	13
Ø 2.7 Locking (bicort.)	10	14,3	13

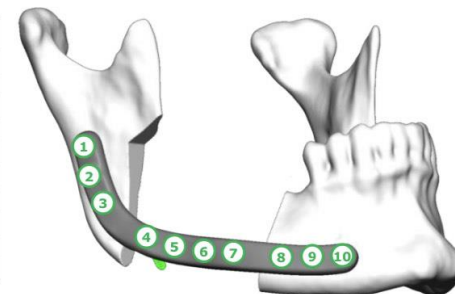



Scansione esame: RX ORTOPANTOMOGRAFIA
(RTO)
n perdita (1:14)

C:2047 L:140
Zona 5



panoramiografia





SERVIZIO SANITARIO REGIONALE
EMILIA-ROMAGNA
Azienda Ospedaliero - Universitaria di Ferrara



Università
degli Studi
di Ferrara

**GRAZIE PER
L'ATTENZIONE**